

FREJA549 and 549N Relay Test System



- **Small, rugged, lightweight, and powerful**
- **Operate with or without a computer**
- **Intuitive manual operation with Smart Touch View Interface or the integrated onboard display**
- **High current, high power output (60 A/319 VA RMS) per phase**
- **Flexible output design - up to four-phase voltages and up to ten-phase currents**
- **Dynamic, transient, and GPS satellite synchronised end-to-end testing capability**
- **IEC 61850 GOOSE testing capability and IEC 61850 9-2 LE sampled values compliant**

DESCRIPTION

The FREJA549 has the “smart” combination of high compliance voltage and high current output to test all electromechanical, solid-state, and microprocessor-based overcurrent relays, including voltage controlled, voltage restraint and high impedance directional ground overcurrent relays.

The FREJA549 provides a complete multi-phase test system for commissioning of protection systems. With up to 4 voltage channels and 6 high current channels, the FREJA549 meets every testing need. The FREJA549 VIGEN modules provide high power in BOTH the voltage and current channels to test virtually all types of protective relays. The FREJA549 test system may be customized by adding the number of Voltage-Current, “VIGEN”, modules needed for specific test applications.

The FREJA549 test system can be manually controlled with the integrated onboard display on the FREJA549 running the new RTMS, Relay Test Management Software. The onboard display, with its large, easy-to-read full colour, high resolution, TFT LCD touch screen allows the user to perform manual, steady-state, and dynamic testing quickly and easily using the manual test screen, as well as using built-in pre-set test routines for most popular relays.

The onboard display eliminates the need for a computer when testing virtually all types of relays. Menu screens and touch screen function buttons are provided to select the desired test function quickly and easily. Tests results can be saved to the internal memory for later download to a USB Thumb drive to transfer or print test reports.

For fully automatic testing every FREJA549 unit is supplied with Relay Test Management Software (RTMS) for installing on a PC. It does not require a security dongle or license to operate and can be loaded on as many customer-owned computers as required. There are two different levels of RTMS, Standard, and Enhanced, see ordering information for details.

APPLICATIONS

The test system may be customized by adding the number of voltage/current, “VIGEN”, modules needed for specific test applications, with a maximum of six channels. For example, the FREJA549 with four VIGEN modules and one DIGEN module provides six-phase currents and four-phase voltages for testing of transformer differential, three-phase impedance, directional power, negative sequence overcurrent and other devices that require a three-phase four-wire wye connected sources. Each current channel is rated for 32 A at 200 VA RMS continuous, and up to 60 A at 319 VA RMS for short durations. For testing relay panels or electromechanical relays, it has a unique flat power curve from 4 to 32 A that always ensures maximum compliance voltage to the load. With a maximum compliance voltage of 50 V RMS per phase, two channels in series provide 100 V to test high impedance relays. With three current channels in parallel the unit can provide up to 180 A at 957 VA for testing all instantaneous overcurrent relays.

Each voltage channel can provide variable outputs of 0 - 30/150/ 300 V at 150 VA of output power and always has a unique flat power curve from 30 to 150 V ensuring maximum output power to the load. With the voltage channels converted to current, a five-channel unit can provide ten currents.

FREJA549 and 549N Relay Test System

MANUAL OPERATION

RTMS in conjunction with the onboard display allows the user to perform manual, steady-state, and dynamic testing quickly and easily. Ergonomically designed with the control knob and touch screen, the powerful RTMS is extremely easy to use.



Figure 1: FREJA549 unit

The most significant feature of RTMS is its ability to provide the user with a very simple way to do manual testing, for both commissioning and maintenance, from the simple overcurrent relay to the most complex relays manufactured today. Manual operation is simplified using a built-in computer operating system and onboard display. The touch screen display and RTMS eliminates the need for a computer when testing virtually all types of relays. Enhanced graphics, intuitive menu screens, and touch screen icon buttons are provided to select the desired test function quickly and easily.

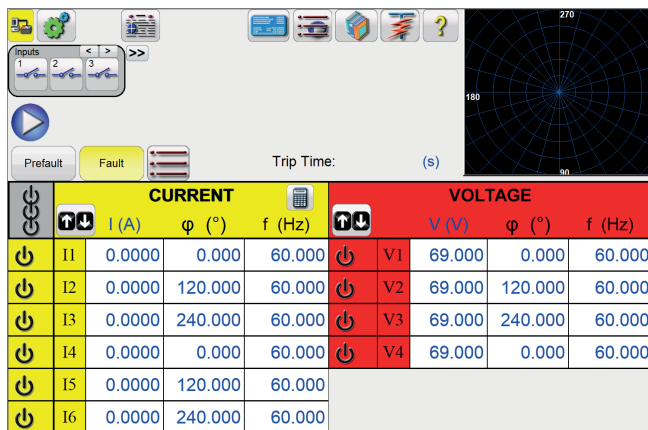


Figure 2: RTMS advanced user interface

For more details on RTMS test capability see the RTMS datasheet.

FEATURES AND BENEFITS

Touch screen display – Easy to use and read, the display provides manual control of the test set. Colour contrasts accentuate vital information. This reduces human error and time in testing relays.

Constant power output – The current amplifier delivers maximum compliance voltage to the load constantly during the test, and range changing is done automatically under load. This ensures better test results and saves time by not having to turn the outputs off to change ranges. Constant power output in many cases eliminates the need to parallel and/or series current channels together to test high burden relays, which also saves time.

High output current – The FREJA549 provides up to 32 A at 200 VA per phase continuous, or up to 60 A at 319 VA with a 1.5 second duty cycle. Three current amplifiers can be paralleled to provide a maximum of 180 A at 957 VA for testing all instantaneous overcurrent relays.

PowerV™ Voltage Amplifier high power output – The FREJA549 provides a high VA output on the voltage channel at the lower critical test voltages (from 30 to 150 V). Users, who want to test a panel of relays at one time, or certain older electromechanical impedance relays, find it impossible using lower VA rated voltage amplifiers. The high burden voltage option in the FREJA549 when enabled allows the unit to output up to 1 A at 300 V.

RTMS graphics and intuitive navigation – New test graphics and intuitive screen navigation saves test time and reduces human error.

Steady-State and Dynamic test capability – The FREJA549 provides, either through manual control or computer control, both steady-state and dynamic testing of protective relays. This includes programmable waveforms with dc offset and harmonics.

Digital inputs and outputs – Up to ten programmable inputs, and six programmable outputs provide timing and logic operations in real-time with the output voltage and currents. Binary Inputs can be programmed, using Boolean logic, for more complex power system simulations. This provides a low cost, closed loop, power system simulator.

Circuit breaker simulator – Binary outputs provide programmable normally closed and normally open contacts to simulate circuit breaker operation for testing reclosing relays. Sequence of operation, timing, and lockout are easily tested.

Perform transient tests – The FREJA549 can perform acceptance or troubleshooting tests by replaying digitally recorded faults, or EMTP/ATP simulations, in the IEEE- C37.111 / IEC 60255-24, COMTRADE Standard format.

Perform end-to-end tests – Using the RTMS Sequencer test; with a Megger MGTR GPS satellite receiver (or suitable IRIG-B time code source input into Binary Input # 1), the FREJA549 performs satellite-synchronised end-to-end tests.

Perform multi-phase tests – The FREJA549 can be interconnected with other FREJA units to increase the total number of test currents for testing multi-phase bus differential protection schemes. For example, a five channel FREJA549 may be interconnected with two more FREJA549 units, providing up to a maximum of thirty current channels.

Three Ethernet ports – The PC IN port is the primary PC connection port. The OUT ethernet port is primarily used to interconnect multiple FREJA units together for synchronous multi-unit operation may be used to connect to the IEC 61850 substation bus. The ISOLATED ethernet port provides secure isolation when testing IEC 61850 devices (for customers who require secure isolation from their IEC 61850 substation bus).

FREJA549 and 549N Relay Test System

Immediate error indication – Audible and visual alarms indicate when amplitude or waveforms of the outputs are in error due to short circuit, open circuit, or thermal overload.

IEC 61850 and Megger GOOSE Configurator – With the IEC 61850 GOOSE option enabled in the FREJA hardware the Megger GOOSE Configurator (MGC) provides mapping of the binary inputs and outputs of the FREJA549 test set to the desired GOOSE messages. The GOOSE messages are read from available SCL (Substation Configuration Language) files or may be automatically detected by scanning the substation network in search of available published GOOSE messages. This scanning process is known as GOOSE “sniffing”. The MGC also provides advanced network troubleshooting tasks such as comparing the GOOSE messages available on the network with the GOOSE messages described in the SCL files with GOOSE MERGE/COMPARE functionality; this is also a powerful tool for validating the horizontal communication description (GOOSE) in the supplied SCD file at Factory Acceptance Tests (FAT) in IEC 61850 substations. This type of verification is also known as GOOSE Consistency Check.

IEC 61850 9-2 LE and Megger Sampled Values Analyser (SVA) – With IEC 61850 9-2 LE Sampled Values option enabled in the FREJA hardware Sampled Values Analyser (SVA) is used as a testing tool that provides the ability to configure a maximum of three Sampled Value (SV) streams compliant with first edition of IEC 61850 9-2 LE to be used in process bus applications for digital substations. As per IEC 61850 9-2 LE guidelines, FREJA can provide three SV data streams with 4 voltages and 4 currents on each stream. Sampled Values (SV) are used for transmitting digitized values of currents and voltages on Ethernet frames using a publisher/subscriber mechanism. In a digital substation environment, merging units are typically used to convert analogue signals from current and voltage transformers into digital streams of data packets at 80 samples per cycle – both for 50 Hz and 60 Hz systems as per IEC 61850 9-2 LE. The merging unit in this scenario acts as an SV publisher. Relays compliant to the protocol can act as an SV subscriber to receive the data packets. Digital signal processors in relays can then process the data measurement and take appropriate actions as per the algorithm. Functional testing of Sampled Values SV-based protective relays with the help of FREJA can be seen as a first step to validate such systems. With the SV-enabled option, FREJA can be used to inject SV streams directly into the relay thereby mimicking merging units. Additionally, FREJA can also be connected to the network and be used as an SV stream monitoring tool. Either of the OUT (PC) or IN ports on FREJA provide the ability to subscribe/publish a maximum of three Sampled Values streams. Minimum hardware requirement to use the IEC 61850 9-2 LE Sampled Values Option – FREJA VIGEN bootloader version $\geq$ 1.052 and firmware 6.259 or higher.

Low-level Rogowski mode – In the Low-level Rogowski mode, the current channels will convert from a current source to a millivolt source. This will allow the current channel to simulate a low-level voltage source from a Rogowski coil. The MLLA will provide filtering of the low-level outputs from the latest version of voltage/current generators in the Megger FREJA series test sets. The MLLA provides the interface from the low-level outputs to the device under test using appropriate interface cables (see MLLA data sheet for ordering and unit compatibility information).

USB 2.0 interface port – The USB port provides a PC interface for automated control of the FREJA unit. Also provides secure isolation when testing IEC 61850 devices (for customers who require secure isolation from their IEC 61850 substation bus).

Low-level output capability – The current generators can provide very low current outputs ranging from 0 to 50 mA full scale or be enabled to provide a voltage output simulating a Rogowski output. In Rogowski mode the current channel will change from a current source to a voltage source, this will allow the current channel to simulate a low-level voltage source from a Rogowski coil. There are three ranges for the Rogowski outputs, 2, 10 and 40 Volts. In the 50 mA mode the feedback loop will stay on down to test currents as low as 5 mA. This provides test capability for generator anti-motoring and Network relays, which can be set as low as 10 to 7.5 mA.

Variable voltage threshold – The variable voltage threshold will either start or stop the Timer. The continuity indicator will glow (application) or not glow (removal) upon the application or removal of either an AC or DC voltage. The programmable voltage threshold is available on binary inputs 1 and 2, with a programmable range from 5 to 150 volts AC/DC.

Open communication architecture – The FREJA549 can be used with third party software for more flexible automated control.

NON-DISPLAY MODEL

A non-display model is offered for those who prefer to only run RTMS from a PC. This reduces cost for those not requiring a touch screen display.

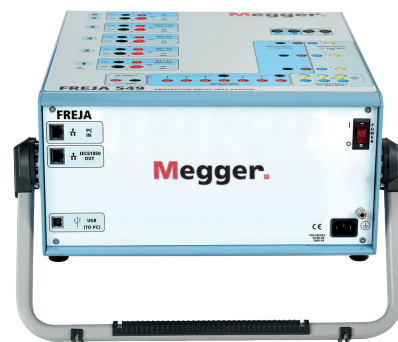


Figure 3: FREJA549N non-display unit

FREJA549 and 549N Relay Test System

SPECIFICATIONS¹

Input power

90 to 264 Volts AC, 1Ø, 50/60 Hz, 1800 VA.

Outputs

All outputs are independent from sudden changes in line voltage and frequency. All outputs are regulated so changes in load impedance do not affect the output. Each output (VIGEN) module consists of one voltage amplifier, and a current amplifier. The voltage amplifier may be converted to a current source. Therefore, one amplifier module may be used to test single phase current differential relays, including harmonic restraint.

Output current sources

The FREJA549 with four VIGEN and one DIGEN (double current) modules can provide up to ten current sources: six high current/high power, and four convertible voltage channels providing lower current/high power. The per channel output current and power ratings are specified in AC RMS values and peak power ratings.

Per channel output

Output current	Power	Max V
50 mA ²	5 VA	10.0 V RMS
1 A	15 VA	15.0 V RMS
4 A	200 VA (282 peak)	50.0 V RMS
15 A	200 VA (282 peak)	13.4 V RMS
32 A	200 VA (282 peak)	6.67 V RMS
60 A	319 VA (450 peak)	5.00 V RMS

DC 200 Watts

Duty cycle: 32 A Continuous, 60 A for ± 1.5 seconds or 90 cycles

Three currents channels in parallel

Output current	Power	Max V
12 A	600 VA (848 peak)	50.0 V RMS
45 A	600 VA (848 peak)	13.4 V RMS
96 A	600 VA (848 peak)	6.67 V RMS
180 A	957 VA (1350 peak)	5.00 V RMS

Four currents channels in parallel

Output current	Power	Max V
16 A	800 VA (1132 peak)	50.0 V RMS
60 A	800 VA (1132 peak)	13.4 V RMS
128 A	800 VA (1132 peak)	6.67 V RMS
240 A	1276 VA (1800 peak)	5.00 V RMS

AC Low-level Rogowski output (converted current channels)^{2/3}

Each current channel can provide the following voltage outputs with the following Ranges:

Output voltage	Max I
0 - 2 V RMS	10 mA
0 - 10 V RMS	100 mA
0 - 40 V RMS	25 mA

Duty cycle: Continuous

Two current channels in series

With two current channels in series, the compliance voltage doubles to provide 4 A at 100 V RMS and up to 32 A at 12.5 V RMS.

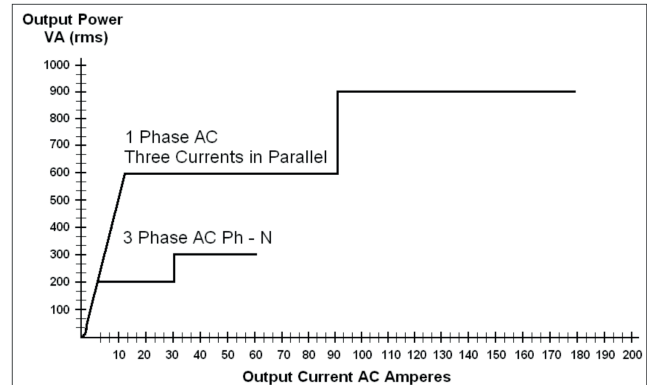


Figure 4: Current output power curve

Current amplifier – extended power range

The FREJA549's current amplifier provides a unique flat power curve from 4 to 32 A per phase to permit testing of electromechanical high impedance relays, and other high burden applications, with an extended operating range up to 60 A at 319 VA RMS for short durations.

AC voltage output

The FREJA549 can provide four voltage sources 0 – 300 V AC/DC.

Outputs are rated with the following ranges:

Output voltage	Power	Max I
2 V ²	0.02 VA	10 mA
30 V	150 VA	5 A
150 V	150 VA	Variable ⁴
300 V	150 VA	0.5 A

DC 150 Watts

Duty cycle: Continuous

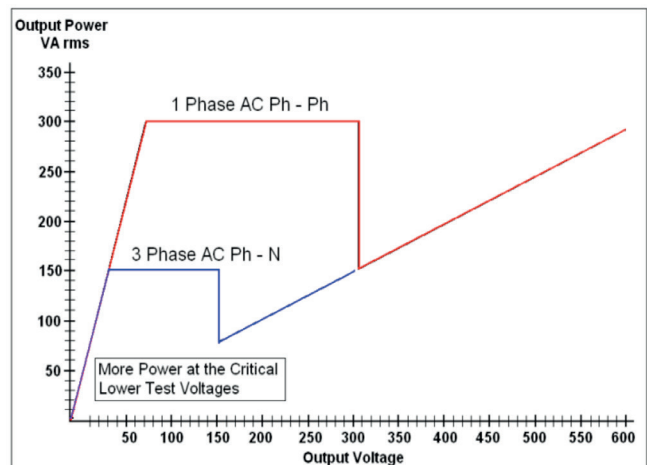


Figure 5: Voltage output power curve

FREJA549 and 549N Relay Test System

"PowerV™" voltage amplifier - extended power range

The FREJA549's voltage amplifier provides a flat power curve from 30 to 150 V in the 150V range to permit testing of high current applications such as panel testing, and older electromechanical distance relays which demand a higher power voltage source to properly test.

Voltage amplifier in current mode

The voltage channels are convertible to a current source with the following output capability. Output power ratings are specified in AC RMS values and peak power ratings.

Output current	Power	Max V
5 A	150 VA (212 peak)	30.0 V RMS
15 A	120 VA	8.0 V RMS

Duty cycle: 5 A Continuous, 15 A for ± 1.5 seconds or 90 cycles

Phase angle

Ranges

0.00 to 359.99 degrees, counterclockwise, or clockwise rotation, or 0.00 to ± 180.00 degrees

Resolution: 0.001

Accuracy: $\pm 0.02^\circ$ typical, $< 0.1^\circ$ guaranteed at 50/60 Hz

Frequency

The output modules provide a variable frequency output with the following ranges and accuracy.

Ranges

DC: 0.001 to 1000.000 Hz

Output amplifiers can provide transient signals with a range of DC to 10 kHz for transient playback using IEEE-C37.111 Standard COMTRADE files.

Resolution: 0.001 Hz

Frequency accuracy: 2.5 ppm typical

25 ppm, 0 to 50° C, at 50/60 Hz maximum

AC/DC AUX: 250 ppm, 50/60 Hz maximum

Total harmonic distortion

Less than 0.1 % typical, 2 % maximum at 50/60 Hz

Metering

Measured output quantities such as AC amperes, AC volts, DC volts or DC amperes, and Time may be simultaneously displayed on the touch screen. Preset AC and DC outputs display the approximate voltage/current output prior to initiation. This provides a fast, easy method for preset of outputs. Other values that may be displayed, depending on which test screen is in view, are phase angle, frequency, Ohms, Watts, VA, and Power Factor. Accuracies are specified from 10 to 100 % of range, 25 °C ± 5 °C, 50-60 Hz.

AC voltage amplitude

Accuracy: ± 0.05 % reading + 0.02 % range typical
 ± 0.15 % reading + 0.05 % range maximum

Resolution: 0.01

Measurements: AC RMS

Ranges: 30, 150, 300 V

DC voltage amplitude

Accuracy: 0.1 % range typical, 0.25 % range maximum

Resolution: 0.01

Measurements: RMS

Ranges: 30, 150, 300 V

AC low-level voltage output²

Range: 2 V

Accuracy: 0 – 1 V: 0.5 mV typical and 1 mV guaranteed
1 – 2 V: 0.5 mV typical and 2 mV guaranteed

Resolution: 0.001

Measurements: AC RMS

AC low-level Rogowski output (converted current channels)^{2/3}

Range: 2 V

Accuracy: 0 – 1 V: 0.5 mV typical and 1 mV guaranteed
1 – 2 V: 0.5 mV typical and 2 mV guaranteed

Resolution: 0.001

Measurements: AC RMS

Ranges: 10, 40 V

Accuracy: ± 0.05 % of reading + 0.02 % of range typical
 ± 0.15 % of reading + 0.05 % of range

guaranteed

Resolution: 0.001

Measurements: AC RMS

AC current amplitude

Accuracy: ± 0.05 % reading + 0.02 % range typical
 ± 0.15 % reading + 0.05 % range maximum

Resolution: 0.001/0.01

Measurements: AC RMS

Ranges: 32, 60 A

AC low current²

Range: 50 mA

Accuracy: ± 0.5 mA typical and 1 mA guaranteed

Resolution: 0.0001

Measurements: AC RMS

DC current amplitude

Accuracy: ± 0.05 % reading + 0.02 % range typical
 ± 0.15 % reading + 0.05 % range maximum

Resolution: 0.001/0.01

Measurements: RMS

Range: 30 A

Convertible source in AC current mode

Accuracy: ± 0.05 % reading + 0.02 % range typical
 ± 0.15 % reading + 0.05 % range or ± 12.5 mA whichever is greater

Resolution: 0.001

Measurements: AC RMS

Ranges: 5, 15 A

Battery Simulator

When the AUX voltage channel is used as a battery simulator there are four common voltage level selections to choose from, 24, 48, 125 & 250 V or a variable DC output ranging from 5 – 250 V at 100 W, 4 A max, providing capability to power up relays with redundant power supplies.

Ranges (DC)	Power	Max I
30 V	100 Watts	3.33 A
250 V	100 Watts	0.4 A

DC Accuracy: Typical $< 1\%$, Guaranteed $< 5\% \pm 1$ V

The Battery Simulator is Galvanically Isolated from other outputs and protected against short circuit and overload conditions.

FREJA549 and 549N Relay Test System

Timer

The timer-monitor Input is designed to monitor and time-tag inputs, like a sequence of events recorder. In addition, the binary input controls enable the user to perform logic AND/OR functions, and conditionally control the binary output relay to simulate circuit breaker, trip, reclose and carrier control operation in real-time. The Timer function displays in Seconds or Cycles, with the following range and resolution:

Seconds:	0.0001 to 99999.9 (Auto ranging)
Cycles:	0.01 to 99999.9 (Auto ranging)
	± 0.001 % of reading, typical
	± 2 least significant digit
	± 0.005 % of reading from 0 to 50 °C maximum

Binary input – start/stop/monitor gate

Up to 10 Independent, galvanically isolated inputs monitor operation of relay contacts or trip SCR, continuity light is provided for the input gate. Upon sensing continuity, the lamp will glow. In addition to serving as wet/dry contacts the Binary Inputs may be programmed to trigger binary output sequence(s).

Input rating:	Up to 300 V AC/DC
Variable voltage threshold:	
Range:	5 – 150 V AC/DC
Accuracy:	5 – 30 V, ± 3 V
	31 – 150 V, ± 6 V

Binary output relays

FREJA549 has independent, galvanically isolated, output relay contacts to accurately simulate relay or power system inputs to completely test relays removed from the power system. The binary output simulates normally open, or normally closed, contacts for testing breaker failure schemes. The binary output can be configured to change state based on binary input logic.

High current output relays 1 to 4:

AC rating:	400 V max., I max: 8 A, 2000 VA max.
DC rating:	300 V max., I max: 8 A, 80 W
Response time:	< 10 ms

High speed output relays 5 and 6:

AC/DC rating:	400 V peak, I max: 1 A
Response time:	< 1 ms typical

Waveform storage

Each output channel can store waveforms for playback on command. End-to-end playback of stored waveforms is possible, when triggered externally by a GPS receiver. Each channel can store up to 256,000 samples.

Protection

Voltage outputs are protected from short circuits and prolonged overloads. Current outputs are protected against open circuits and overloads.

DC IN inputs (optional transducer feature)

DC IN voltage

Range:	0 to ± 10 V DC
Accuracy:	± 0.001 % reading + 0.005 % range typical ± 0.003 % reading + 0.02 % range max
Resolution:	0.001
Measurements:	Average

DC IN Amperes

Ranges:	0 to ± 1 mA DC 4 to ± 20 mA DC
Accuracy:	± 0.001 % reading + 0.005 % range typical ± 0.003 % reading + 0.02 % range max
Resolution:	0.001
Measurements:	Average

Environmental

Operating temperature:	32 to 122 °F (0 to 50 °C)
Storage temperature:	-13 to 158 °F (-25 to 70 °C)
Relative humidity:	5 – 95 % RH, non-condensing

CE-marking

EMC	EN 61326:
LVD	EN/IEC 61010-1:2001 (Second Edition)

Conformance standards

Safety:	EN 61010-1
Shock:	EN/IEC 60068-2-27
Vibration:	EN/IEC 60068-2-6
Transit drop:	ISTA 1A
Free fall:	EN/IEC 60068-2-32
Drop/topple:	EN/IEC 60068-2-31

Electromagnetic compatibility

Emissions:	EN 61326-2-1, EN 61000-3-2/3, FCC Subpart B of Part 15 Class A
Immunity:	EN 61000-4-2/3/4/5/6/8/11

Weight

42.65 lb. (19.2 kg)

Dimensions

13.25 W x 6.75 H x 15 D in.
337 W x 172 H x 381 D mm

Enclosure and transit cases

The unit comes mounted in a rugged metal enclosure for field portability.

IEC enclosure rating: IP30


Optional hard-sided transit case is available for the FREJA549.

The robust design of the optional hard-sided transit case provides protection when transporting the unit over rugged terrain and long distances. An optional soft-sided carry case for the FREJA549 protects the unit from light rain and dust. The padded sides provide moderate protection while in transit.

FREJA549 and 549N Relay Test System

ORDERING INFORMATION

STYLE NUMBER IDENTIFICATION

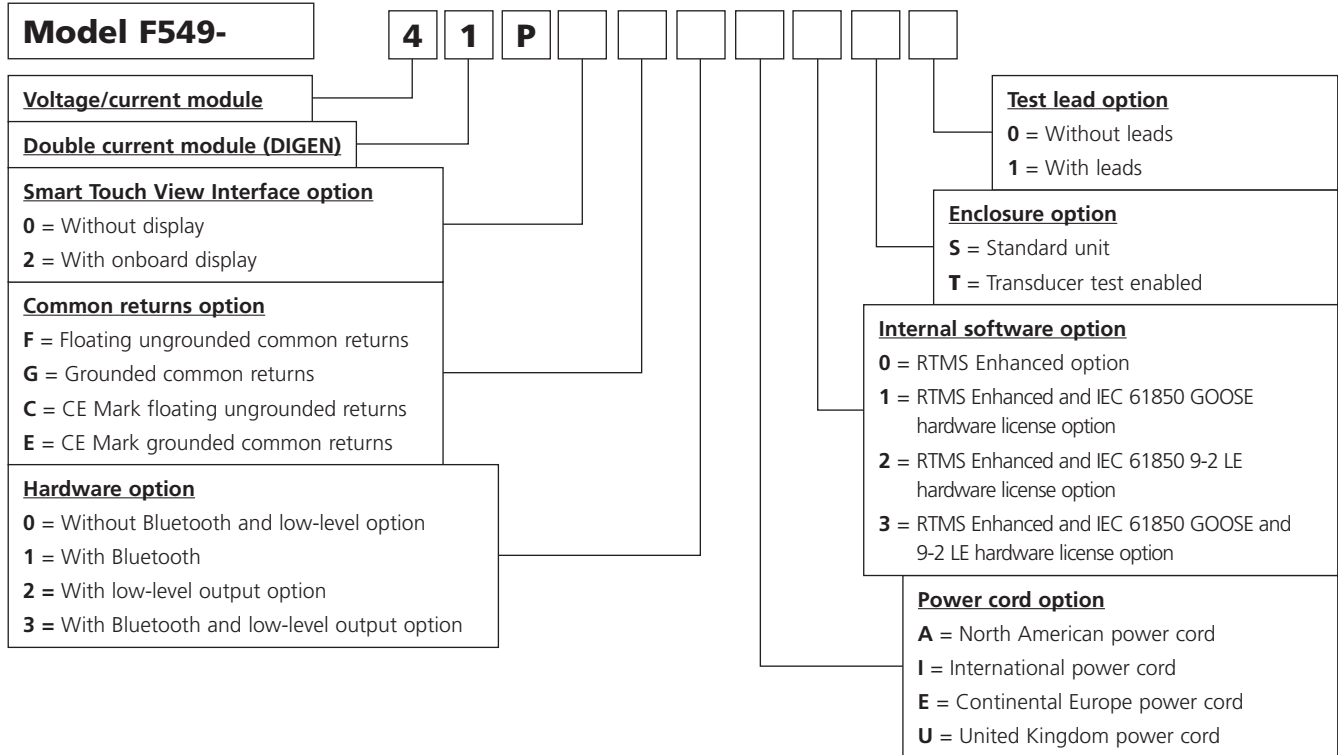

DESCRIPTIONS OF HARDWARE OPTIONS

This modular system lets you select the testing capabilities you need and expand as testing requirements change. Customize the system by selecting floating or grounded common returns, power cord, IEC 61850 test capable, and/or RTMS Enhanced options, standard hardware or transducer feature added, and with or without test leads. See the following descriptions:

Voltage/current module: The FREJA549 unit four voltage/current modules.

Double current module: The FREJA549's **fifth slot** comes with a current (DIGEN) module.

Smart Touch View Interface option: Enter the number **0** for the unit to be supplied without a display or the number **2** for the unit to be supplied with an onboard display.

Common returns option: The floating returns option provides independent isolated return terminals for each output channel. The grounded common returns option, the return terminals are interconnected internally and connected to chassis ground. The CE Mark, **C** and **E** units, have been certified to the IEC standards for EMC for both the grounded and floating options. The **F** and **G** units are designed to operate in countries which do not require the CE mark.

Hardware option:

- 0** = Enter the number **0** for the unit to be supplied without the Bluetooth and low-level option.
- 1** = Enter the number **1** for the unit to be supplied with the Bluetooth option.
- 2** = Enter the number **2** for the unit to be supplied with the low-level option.
- 3** = Enter the number **3** for the unit to be supplied with the Bluetooth and low-level option.

Power cord option: Customers can choose which type of power cord they want the unit to come with.

- **A** option – NEMA 5-15 to IEC60320 C13 connectors, UL and CSA approved for countries with NEMA outlets.
- **I** option – International colour-coded wires (light blue, brown, and green with yellow stripe) insulation jacket stripped ready for male connector with IEC 60320 C13 connector. CE marked.
- **E** option – CEE 7/7 "Schuko" plug to IEC 60320 C13 connector is CE marked.
- **U** option – United Kingdom power cord with IEC 60320 C13 connector, and 13 A fuse. BS 1363 / CE marked.

Internal software option:

- 0** = Enter the number **0** for the unit to be supplied with RTMS Enhanced option.
- 1** = Enter the number **1** for the unit to be supplied with the IEC 61850 GOOSE hardware license enabled on the unit.
- 2** = Enter the number **2** for the unit to be supplied with the IEC 61850 9-2 LE hardware license enabled on the unit.
- 3** = Enter the number **3** for the unit to be supplied with IEC 61850 GOOSE and IEC 61850 9-2 LE hardware licenses enabled.

FREJA549 and 549N Relay Test System

Enclosure option: **S** = Standard unit. **T** = With transducer test capability enabled (requires 3 channel configuration). When equipped with the transducer test feature the total number of binary inputs and outputs are reduced by 1.

Test leads option: Enter the number **1** for the unit to be supplied with test leads. Enter **0** for the unit without test leads.

DESCRIPTION OF SOFTWARE OPTIONS

Included software	Part Number
RTMS Enhanced	84973
Optional software	
Megger GOOSE Configurator and Sampled Values Analyser stand-alone software	1007-246
IEC 61850 GOOSE hardware upgrade kit	83646
IEC 61850-9-2LE Sampled Values hardware upgrade kit	88695
FREJA IEC 61850 GOOSE and IEC 61850-9-2LE Sampled Values hardware upgrade kit	88696
Low-level hardware upgrade kit (includes Rogowski, low-current and variable voltage on B/I 1 and 2 feature) ^{2/3}	87416

DESCRIPTIONS OF SOFTWARE

Included software

Every unit is supplied with Relay Test Management Software (RTMS) for installing on a PC. The software does not require a security dongle or license to operate and can be loaded on as many customer-owned computers as required. The powerful RTMS can be run directly from a PC providing both manual and automatic test capabilities. See the RTMS datasheet for more detailed descriptions of test features and capabilities.

RTMS Template Manager – RTMS Template Manager is included with RTMS, allowing users to download new versions of relay templates as they are released from the Megger Cloud and will update the user's local PC data base (Internet connection is required). RTMS Template Manager also provides documents and how-to videos to support relay testing.

Additional optional software

Megger GOOSE Configurator software – The FREJA unit is certified by KEMA as being compliant with IEC 61850 protocol. With the IEC 61850 GOOSE hardware enabled, in conjunction with the Megger GOOSE Configurator (MGC) software, the FREJA unit can be used in the testing or commissioning of IEC 61850 compliant devices. See RTMS datasheet for details.

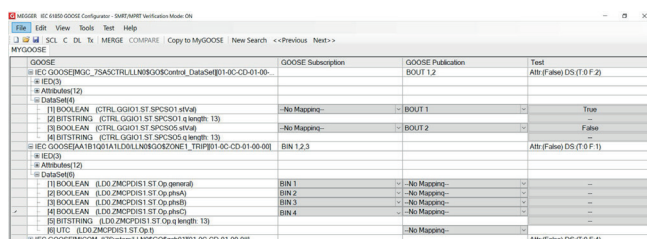


Figure 6: Megger GOOSE Configurator software

Megger Sampled Values Analyser software – The FREJA unit is certified by KEMA as being compliant with IEC61850-9-2LE guidelines. With the IEC 61850 Sampled Values hardware enabled, in conjunction with the Megger Sampled Values Analyser software, the FREJA unit is user configurable to provide Sampled Values for testing or commissioning devices which require Sampled Values. When configured, the FREJA unit can provide three data streams of four voltages and four currents each.

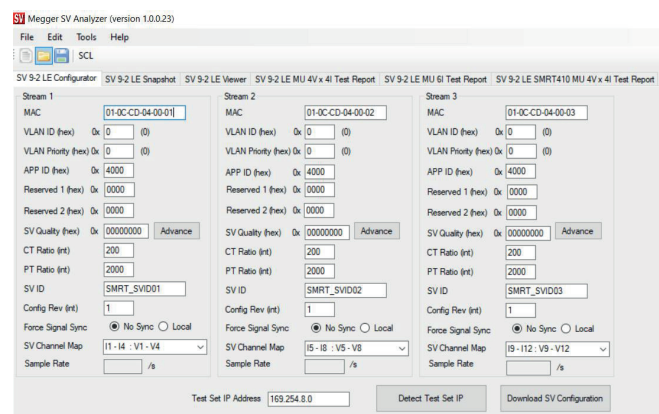


Figure 7: Megger Sampled Values Configurator

FREJA549 and 549N Relay Test System

FREJA IEC 61850 GOOSE license upgrade kit – The IEC 61850 GOOSE test feature is a hardware enabled option. RTMS will automatically recognize if the GOOSE feature is enabled in the FREJA. There are two ways to determine if the unit has the IEC 61850 test capability enabled: First there is nameplate or a sticker on the back of the unit that will state "IEC 61850 ENABLED". The second way to determine if the unit has been enabled is to power up the unit and go to the Configuration Screen in RTMS and it will either state IEC 61850 ENABLED or DISABLED. The IEC 61850 GOOSE test feature can be enabled by the customer in the field by purchasing the IEC 61850 GOOSE license upgrade kit, part number 1001-044. The kit will include an IEC 61850 GOOSE license certificate, with a unique 32-digit code number assigned specifically to the unit (requires the customer to provide the unit serial number when ordering the kit). The kit also includes step-by-step instructions on how to enable the feature with the 32-digit code.

FREJA IEC 61850 Sampled Values license upgrade kit – The IEC 61850-9-2LE Sampled Values test feature is a hardware enabled option. The IEC 61850-9-2LE Sampled Values test feature can be enabled by the customer in the field by purchasing the FREJA IEC 61850-9-2LE Sampled Values License Upgrade Kit, part number 88695. The kit will include an IEC 61850-9-2LE Sampled Values License Certificate, with a unique 32-digit code number assigned specifically to the unit (requires the customer to provide the unit serial number when ordering the kit). The kit also includes step-by-step instructions on how to enable the feature with the 32-digit code.

FREJA IEC 61850 GOOSE and IEC 61850-9-2LE Sampled Values hardware upgrade kit – The IEC 61850 GOOSE and IEC 61850-9-2LE Sampled Values test feature can be enabled by the customer in the field by purchasing the IEC 61850 GOOSE and FREJA IEC 61850-9-2LE Sampled Values hardware upgrade kit, part number 88696. The kit will include IEC 61850 GOOSE and IEC 61850-9-2LE Sampled Values license certificates, with unique 32-digit code numbers assigned specifically to the unit (requires the customer to provide the unit serial number when ordering the kit). The kit also includes step-by-step instructions on how to enable these features with the 32-digit code.

TEST LEADS AND ACCESSORIES

All units are supplied with a power cord, an Ethernet communication cable, and instruction manual on a USB thumb-drive.

Included standard accessories	Part number
Power Cord - Depending on the style number, the unit will be supplied with one of the following:	
Line cord, North American	620000
Line cord, Continental Europe with CEE 7/7 Schuko Plug	50425
Line cord, International colour-coded wire	15065
Line cord, United Kingdom	90002-989
Ethernet cable for interconnection to PC, 210cm (7 ft.) long (Qty. 1 ea.)	90003-684
Instruction manual USB	80989

FREJA549 and 549N Relay Test System

TABLE OF ACCESSORIES

Test leads and accessories are supplied with the selection of the test leads option for a typical configuration as follows: FREJA549-41P0F0I0S1. With the test leads option, the number and type of leads varies depending on the unit that is ordered. Test leads and accessories can be ordered individually, see part numbers below.

	Descriptions of test leads and accessories	Quantity	Part number
	Accessory carry case: Used to carry power cord, ethernet cable, optional STVI, test leads and accessories.	1	2003-725
	Sleeved pair of test leads: Sleeved test leads, one red , one black , 200 cm (78.7 in) long, 600 V, 32 A CAT II	2	2008-539-2
	Cable/spade lug adapter (small): Small lug fit most new relay small terminal blocks. Lug adapter, red , 4.1 mm, rated up to 1000 V/20 A CAT II	14	684004
	Cable/spade lug adapter (small): Small lug fit most new relay small terminal blocks. Lug adapter, black , 4.1 mm, rated up to 1000 V/20 A CAT II	14	684005
	Jumper lead: Jumper lead, black , 12.5 cm (5 in) long, use with voltage/current outputs, 600 V, 32 A CAT II	6	2001-573
	Sleeved combination voltage test leads: Three common leads connect to the test set, which are interconnected to one black common to connect to the relay. Sleeved, three red and black , 200 cm (78.7 in) long, 600 V, 32 A CAT II	1	2008-540-2
	Sleeved combination current test leads: Three pairs of leads connect to the test set, and to the relay under test. Sleeved, three red and black , 200 cm (78.7 in) long, 600 V, 32 A CAT II	1	2008-541-2

ADDITIONAL TEST LEADS AND ACCESSORIES (TRANSDUCER OPTION)

The following additional test leads, and accessories are supplied with the selection of the **Transducer option**. Test leads and accessories can be ordered individually, see part numbers and descriptions below.

	Descriptions of optional test leads and accessories	Quantity	Part number
	Cable/spade lug adapter (small): Small lug fit most new relay small terminal blocks. Lug adapter, red , 4.1 mm, rated up to 1000 V/ 20 A CAT II	2	684004
	Cable/spade lug adapter (small): Small lug fit most new relay small terminal blocks. Lug adapter, black , 4.1 mm, rated up to 1000 V/ 20 A CAT II	2	684005

FREJA549 and 549N Relay Test System

ADDITIONAL TEST LEADS AND ACCESSORIES (DIGEN OPTION)

The following additional test leads, and accessories are supplied with the selection of the **DIGEN option**. Test leads and accessories can be ordered individually, see part numbers and descriptions below.

	Descriptions of optional test leads and accessories	Quantity	Part number
	Sleeved pair of test leads: Sleeved test leads, one red , one black , 200 cm (78.7 in) long, 600 V, 32 A CAT II.	2	2008-539-2
	Cable/spade lug adapter (small): Small lug fit most new relay small terminal blocks. Lug adapter, red , 4.1 mm, rated up to 1000 V/ 20 A CAT II	2	684004
	Cable/spade lug adapter (small): Small lug fit most new relay small terminal blocks. Lug adapter, black , 4.1 mm, rated up to 1000 V/ 20 A CAT II	2	684005

OPTIONAL TEST LEADS AND ACCESSORIES (NOT INCLUDED IN THE FREJA549 TEST LEAD OPTION)

Optional test leads and accessories can be ordered individually, see description and part numbers below. **The following accessories and part numbers are in quantities of 1 each. Order the appropriate number required.**

	Descriptions of optional test leads and accessories	Quantity	Part number
	Sleeved pair of test leads: Sleeved test leads, one red , one black , 300 cm (118.11 in) long, 600 V, 32 A CAT II.	1	2008-539-3
	Sleeved combination voltage test leads: Three common leads connect to the test set, which are interconnected to one black common to connect to the relay. Sleeved, three red and black , 300 cm (118.11 in) long, 600 V, 32 A CAT II	1	2008-540-3
	Sleeved combination current test leads: Three pairs of leads connect to the test set, and to the relay under test. Sleeved, three red and black , 300 cm (118.11 in) long, 600 V, 32 A CAT II	1	2008-541-3
	Sleeved pair of test leads: Sleeved test leads, one red , one black , 600 cm (236.22 in) long, 600 V, 32 A CAT II.	1	2008-539-6
	Sleeved combination voltage test leads: Three common leads connect to the test set, which are interconnected to one black common to connect to the relay. Sleeved, three red and black , 600 cm (236.22 in) long, 600 V, 32 A CAT II	1	2008-540-6
	Sleeved combination current test leads: Three pairs of leads connect to the test set, and to the relay under test. Sleeved, three red and black , 600 cm (236.22 in) long, 600 V, 32 A CAT II*	1	2008-541-6
	Individual (non-sleeved) test leads: Excellent for widely separated individual terminal test connections. Test lead, red , use with voltage/current output, or binary I/O, 200 cm long (78.7 in) 600 V/32 A CAT II.	1	620143
	Individual (non-sleeved) test leads: Excellent for widely separated individual terminal test connections. Test lead, black , use with voltage/current output, or binary I/O, 200 cm long (78.7 in) 600 V/32 A CAT II.	1	620144

FREJA549 and 549N Relay Test System

	Descriptions of optional test leads and accessories	Quantity	Part number
	Individual (non-sleeved) extra-long test leads: Excellent for widely separated individual terminal test connections. Extra-long test lead, black , use with voltage/current output, or binary I/O, 360 cm long (12 ft) 600 V/ 32 A CAT II.	1	2003-172
	Individual (non-sleeved) extra-long test leads: Excellent for widely separated individual terminal test connections. Extra-long test lead, red , use with voltage/current output, or binary I/O, 360 cm long (12 ft) 600 V/ 32 A CAT II.	1	2003-173
	Cable/spade lug adapter (large): Large spade lug fits older relay terminal blocks, or STATES® Company FTP10 or FTP14 test paddles, ABB, or General Electric test plugs with screw down terminals. Lug adapter, red , 6.2 mm, use with test leads up to 1000 V/20 A CAT II.	1	684002
	Cable/spade lug adapter (large): Large spade lug fits older relay terminal blocks, or STATES® Company FTP10 or FTP14 Test paddles, ABB, or General Electric test plugs with screw down terminals. Lug adapter, black , 6.2 mm, use with test leads up to 1000 V/20 A CAT II.	1	684003
	Alligator/crocodile clip: Excellent for test connections to terminal screws and pins where spade lugs cannot be used. Alligator clip, red , use with test leads up to 1000 V/32 A CAT III.	1	684006
	Alligator/crocodile clip: Excellent for test connections to terminal screws and pins where spade lugs cannot be used. Alligator clip, black , use with test leads up to 1000 V/32 A CAT III.	1	684007
	Flexible test lead adapter with retractable insulated sleeve: Use for connection to old style non-safety sockets with retractable protective sleeve on one end. Retractable sleeve test lead, red , 50 cm (20 in) long, use with test leads up to 600 V/32 A CAT II.	1	90024-781
	Flexible test lead adapter with retractable insulated sleeve: Use for connection to old style non-safety sockets with retractable protective sleeve on one end. Retractable sleeve test lead, black , 50 cm (20 in) long, use with test leads up to 600 V/32 A CAT II.	1	90024-780
	Flexible test lead adapter: Use with rail-mounted terminals or screw clamp connections where spade lugs and crocodile/alligator clips cannot be used. Flexible test lead adapter, black , 1.8 mm male pin, use with test leads up to 1000 V/32 A CAT III.	1	90001-845
	Parallel test lead adapter: Used when paralleling up to three current test leads together to a common test point. Usually used when connecting to a test paddle (like the pictured States Company test paddle.)	1	1002-286
	RLC, Relay Lead Connector: Excellent for easily connecting three-phase voltage and current leads to the test system. Two sets of test leads (one for voltages and one for currents), sleeved, 4 mm (0.16 in) terminals with retractable safety shrouds, colour coded red, yellow, blue, black , 200 cm long (78.7 in) 600 V/ 32 A CAT II	1	RLC
	Arc Flash Simulator: The Megger arc flash simulator provides a focused high-intensity bright white light to simulate an arc flash for testing arc flash protection relays and systems.	1	AFS
	Megger Low Level Adapter (Set of three filters): The MLLA provides filtering of the low-level outputs from the latest version ² of voltage/current generators in the Megger FREJA series test sets. It also provides the interface from the low-level outputs to the device under test using appropriate interface cables. For individual filters and interface cables, see the MLLA datasheet.	Set of three filters	MLLA
	Megger GPS timing reference: The MGTR is a small, lightweight, field portable, GPS satellite receiver system specifically designed to perform end-to-end tests of line protection schemes. The unit comes with a GPS Antenna, power supply, and a stainless-steel antenna mount. Cable length depends on the ordering part number.		
	GPS unit with all-weather antenna, power supply, and 15 m cable	1	MGTR-II-50
	GPS unit with all-weather antenna, power supply, and 30 m cable	1	MGTR-II-100
	STATES® 10-pole test paddle: Use with STATES FMS test switch or ABB FT-1 10-pole test switch. Test paddle features knobs which also serve as insulated Ø 4 mm rigid socket accepting spring loaded Ø 4 mm plugs with rigged insulating sleeve, or retractable sleeve. Use with test leads up to 600 V, 32 A CATII.	1	V1TP10

FREJA549 and 549N

Relay Test System

	Descriptions of optional test leads and accessories	Quantity	Part number
	STATES® 10-pole test paddle attachment: Use with STATES V1TP10 test paddle. The test paddle attachment provides an additional 10 insulated connection points for front connection, as well as the standard top connections for test leads. Adapter can provide convenient parallel test connections of test currents to two terminals at one time. Use with test leads up to 600 V, 32 A CAT II.	1	TPA10
	Hard-Sided Transit Case: Includes custom designed foam inserts for the FREJA549 unit and accessories. Transit case includes retractable handle, built-in wheels, twist and lock-down latches, spring-loaded fold-down handles, with O-ring seal.	1	1007-363
	Soft-sided carry case: The soft-sided carry case protects the FREJA549 unit from light rain and dust. The padded sides provide moderate protection while in transit.	1	2007-218

¹ Megger reserves the right to change product specifications at any time.

² Requires VIGENS with hardware version 3.5.1 or higher.

³ For the ability to test relays with low level inputs by simulating signals from non-conventional CTs and VTs with low level interfaces, i.e., Rogowski coils will require the Megger MLLA (Low Level Adapter).

⁴ PowerV™ voltage amplifier output current varies depending on the voltage setting on the 150 Volt range, see curve.

SALES OFFICE

Megger Limited
Archcliffe Road Dover
CT17 9EN England
T. +44 (0) 1304 502101
E. UKsales@megger.com

FREJA549_549N_DS_EN_v12

www.megger.com
ISO 9001
The word 'Megger' is a registered trademark

Megger ^R